

DI0190/DU01

Thermal Resistance of Evergreen R1.5



Author: Sheng-Huei Huang Technician IANZ Approved Signatory

Reviewer:Roger StanfordSenior TechnicianIANZ Approved Signatory

All tests reported herein have been undertaken at the BRANZ Ltd laboratories located in Judgeford, Porirua, New Zealand, unless stated otherwise.

Contact:

BRANZ Limited Moonshine Road Judgeford Private Bag 50908 Porirua City New Zealand Tel: +64 4 237 1170 Fax: +64 4 237 1171 www.branz.co.nz



International Accreditation New Zealand (IANZ) has a Mutual Recognition Agreement (MRA) with the National Association of Testing Authorities, Australia (NATA). Users of test reports are recommended to accept test reports in the name of either accrediting body.





BRANZ's agreement with its Client in relation to this report contains the following terms and conditions in relation to *Liability and Indemnification*

- a. Limitation and Liability
 - i. BRANZ undertakes to exercise due care and skill in the performance of the Services and accepts liability to the Client only in cases of proven negligence.
 - ii. Nothing in this Agreement shall exclude or limit BRANZ's liability to a Client for death or personal injury or for fraud or any other matter resulting from BRANZ's negligence for which it would be illegal to exclude or limit its liability.
 - BRANZ is neither an insurer nor a guarantor and disclaims all liability in such capacity.
 Clients seeking a guarantee against loss or damage should obtain appropriate insurance.
 - iv. Neither BRANZ nor any of its officers, employees, agents or subcontractors shall be liable to the Client nor any third party for any actions taken or not taken on the basis of any Output nor for any incorrect results arising from unclear, erroneous, incomplete, misleading or false information provided to BRANZ.
 - v. BRANZ shall not be liable for any delayed, partial or total non-performance of the Services arising directly or indirectly from any event outside BRANZ's control including failure by the Client to comply with any of its obligations hereunder.
 - vi. The liability of BRANZ in respect of any claim for loss, damage or expense of any nature and howsoever arising shall in no circumstances exceed a total aggregate sum equal to 10 times the amount of the fee paid in respect of the specific service which gives rise to such claim or NZD\$50,000 (or its equivalent in local currency), whichever is the lesser.
 - vii. BRANZ shall have no liability for any indirect or consequential loss (including loss of profits).
 - viii. In the event of any claim the Client must give written notice to BRANZ within 30 days of discovery of the facts alleged to justify such claim and, in any case, BRANZ shall be discharged from all liability for all claims for loss, damage or expense unless legal proceedings are commenced in respect of the claim within one year from:
 - The date of performance by BRANZ of the service which gives rise to the claim; or
 - The date when the service should have been completed in the event of any alleged non-performance.
- b. Indemnification: The Client shall guarantee, hold harmless and indemnify BRANZ and its officers, employees, agents or subcontractors against all claims (actual or threatened) by any third party for loss, damage or expense of whatsoever nature including all legal expenses and related costs and howsoever arising relating to the performance, purported performance or non-performance, of any Services.
- c. Without limiting clause b above, the Client shall guarantee, hold harmless and indemnify BRANZ and its officers, employees, agents or subcontractors against all claims (actual or threatened) by any party for loss, damage or expense of whatsoever nature including all legal expenses and related costs arising out of:
 - i. any failure by the Client to provide accurate and sufficient information to BRANZ to perform the Services;
 - ii. any misstatement or misrepresentation of the Outputs, including Public Outputs;
 - iii. any defects in the Products the subject of the Services; or
 - iv. any changes, modifications or alterations to the Products the subject of the Services.



Thermal Resistance of Evergreen R1.5

1. CLIENT

Platinum Insulation Wholesalers P/L, 604 Terrigal Drive, Erina, NSW 2250, Australia

2. LIMITATION

The results reported here relate only to the item/s tested.

3. DESCRIPTION OF TEST SAMPLES

Five sample segments were selected from the supplied material, in accordance with ASTM C167-09 and the modifications required by AS/NZS 4859.1-02.

Net pack weights (kg) (of the test sample)	22.1

Table 1. Product specifications

Label information (Information r	equired b	y AS/NZS 4859.1 Table 3.1 Labelling)		
		ng RRJSC REVENUE Is the Article of the Company and addition of the Company and the Company an		
Product name		Evergreen Glass Wool Insulation		
Description of contents		Glass Wool Insulation		
Manufacturer		United Insulation Limited		
Traceability information				
Manufacturing address		No.09 United Road, E & T Zone Langfang City 065000, China		
Date of manufacture		July 10, 2010		
Batch number		1007C		
Safety instructions		Yes		
Statement of compliance with AS/NZS 48	359.1			
including specifications consistent with th		Yes		
sample nominal thickness and weight				
Statement of performance dependence of	n	Yes		
storage time in compression package		100		
Statement of R-value dependence on ins	tallation	Yes		
Declaration of temperature conditions		Yes, 23°C		
Time to achieve nominal thickness		Yes, 24 hrs		

Table 1. continued on next page

SHH

SHH





Table 1. continued from previous page

Table 1. continued nom provide page					
Number of pieces	(not required for rolls)	32			
Total area	(m ²)	16			
Length	(mm or m)	1160			
Width	(mm or m)	430			
R-value (m ² K/W)		1.5			
Net weight (kg for pac	k or 'grams per sq. metre')	19.5			
Nominal thickness	(mm)	95			

4. DESCRIPTION OF TEST EQUIPMENT

The test equipment used was a LaserComp Fox600 heat flow meter. The specimen for testing is placed horizontally in the apparatus, with upwards heat flows. The hot and cold plates each have a 250 mm x 250 mm heat flux transducer embedded in their surface. The edges of the specimen are insulated from the room ambient temperature. The uncertainty in individual thermal conductivity and thermal resistance measurements is estimated to be 3%.

5. **PROCEDURE**

SHH

SHH

BRANZ

Five sample segments were selected and prepared, and the thickness measured, to the requirements of ASTM C167 & AS/NZS 4859.1 Appendix D. The variations from the ASTM C167-AS/NZS 4859.1 procedure were as follows:

- Fifteen individual thickness measurements were made for each determination of thickness for a segment instead of the ten described in the standard.
- These measurements were spread in an equally spaced three by five grid instead of the particular arrangement outlined in the standard.

The five sample segments were conditioned for 24 hours at 23°C prior to the thermal performance measurements.

The three test segments were selected from the five sample segments then cut and made up to the required test specimen size of approximately 600 mm square. The 'grams per square metre' of the test specimen is assumed to be the same as the complete segment from which it is cut (approximately twice the area of the test specimen).

The specimens were tested to the requirements of ASTM C518-10 using the procedures of ASTM C653-97 including the modifications specified in AS/NZS 4859.1-02 Appendix D. See the BRANZ information sheet '*Notes on R-value measurement using ASTM C653 procedure*'. A total of nine measurements of thermal resistance were made for three values of density by testing first at an initial thickness (the lesser of the mean conditioned thickness, and, the nominal thickness plus 10%), then compressing the specimen to a thickness approximately 10% less than the initial test, and finally compressing the specimen to a thickness approximately 20% less than the initial test thickness.

		RSS
Report Number: DI0190/DU01	Date of Issue: 4 August 2010	Page 4 of 8 Pages

BRANZ reference	D4932				
	Г	Thickness (mm) 'grams			
	average	max	min	metre' (g/m ²)	
Initial	91	100	73	1324	
After conditioning @ 23°C for 24 hours	93	101	78	1324	
change	+3%			+0.0%	
Std. dev. of 5 x 15 thickness measurements		5 mm			

Table 2. Conditioning of five sample segments

Table 3. Test condition set-points

Upper plate set-point temperature	9.9 °C
Lower plate set-point temperature	36.1 °C
Nominal difference in temperature	26.2 K
Nominal mean temperature	23.0 °C

Table 4. Measured results for the three test specimens

Calibration date	Calibration date 02-Aug-10			Calibration sample			SR 06			
Test specimen	est specimen		Specimen 1		S	Specimen 2		Specimen 3		
BRANZ reference			D4932B			D49320)	D4932D		
'grams per sq. metre' (of segment from whicl specimen is cut)	n test g/m ²		1466			1384			1183	
Test date		4-08	4-08	4-08	4-08	4-08	4-08	5-08	5-08	5-08
Test thickness	mm	98.0	89.0	80.0	95.0	87.0	78.0	90.0	82.0	74.0
Density at test thicknes (of segment from whick specimen is cut)		14.96	16.47	18.32	14.56	15.90	17.74	13.14	14.42	15.98
Temperature difference	e K	26.20	26.20	26.20	26.20	26.20	26.20	26.20	26.20	26.20
Mean temperature	°C	23.0	23.0	23.0	23.0	23.0	23.0	23.0	23.0	23.0
Heat-flux	W/m ²	11.01	11.73	12.66	11.54	12.24	13.20	13.40	14.16	15.11
Thermal resistance	m ² K/W	2.379	2.233	2.070	2.271	2.141	1.985	1.955	1.850	1.734
Thermal conductivity	mW/mK	41.2	39.9	38.7	41.8	40.6	39.3	46.0	44.3	42.7
Difference between he flux transducers	at %	0.2	0.4	0.6	1.0	1.2	1.2	0.1	0.1	0.1
The results represent the average of at least 18 minutes of measurements taken after equilibrium of heat flow is achieved.										

The results represent the average of at least 18 minutes of measurements taken after equilibrium of heat flow is achieved. Equilibrium conditions are maintained for at least 12 minutes before the averaging of results is started. Actual times are available on request.

The analysis of the results was in accordance with the guidelines in ASTM C653-97.

The relationship between thermal conductivity and density for an insulation material can be represented by an equation of the form:

Thermal conductivity (W/mK)
$$\lambda = a + b.\rho + \frac{c}{\rho}$$
 where ρ is density (kg/m³)

SHH.

SHH





Over the range of densities created with the test specimens, the coefficients have been determined by regression fit through the results and are listed in Table 5. The best fit equation for the results is plotted in Figure 1.

Thermal Conductivity				
	а	b	С	
Specimen 1	0.0178	+0.00029	0.284	
Specimen 2	0.0229			
Specimen 3	0.0169	+0.00036	0.320	Standard error
Combined results	-0.0242	+0.00144	0.671	2.6%
Uncertainty in individu	3%			
Overall uncertainty in u	4%			

 Table 5.
 Regression- fit for measurements at 23°C mean temperature

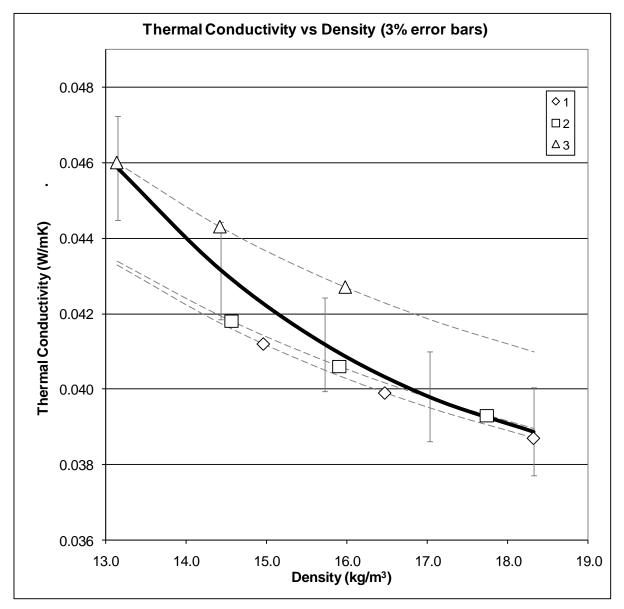


Figure 1. Summary of thermal conductivity measurements at 23°C mean temperature $SHH_{}$

SHH



RSS

Table 6.	Summary and analysis of results
----------	---------------------------------

95 ± 1219	2	mm mm
	2	mm
1219		
		g/m ²
1 ±	16	g/m²
b ±	0.4	kg/m ³
) ±	0.2	°C
.0434	1	W/mK
2.14		m ² K/W
13.1		kg/m ³
.0459)	W/mK
1.5		m ² K/W
2.02		m ² K/W
	3 ±) ±).0434 2.14 13.1).0459	3 ± 0.4 0 ± 0.2 0.0434

*¹⁻¹⁸ See BRANZ info sheet 'Glossary of terms used in Table 6 of Thermal Testing Reports'

The test method was in accordance with ASTM C653 and AS/NZS 4859.1:02 Appendix D, including the alternative thickness probe diameter of 25 mm and pressure of 25 Pa allowed for in Amendment 1 (2006) of AS/NZS 4859.1

Table 7.	Assessment of product compliance with labelled specifications
----------	---

Compliance Requirement	Pass/Fail
Packaging & labelling compliance with AS/NZS 4859.1 Section 3*	Pass
Result compared with declared R-value (AS/NZS 4859.1 clause 2.3.3.7 prgph 1)	Pass
Combined	Pass

* Note – The pass requirement includes that there is a manufacturer address present but BRANZ has not necessarily checked that it is the address where the product is actually made. The results are only valid for a unique and unambiguous address of manufacture.



SHH





7. **REFERENCES**

AS/NZS 4859.1:02	Materials for the thermal insulation of buildings; Part 1: General criteria and technical provisions. Standards Australia, Sydney, Standards New Zealand, Wellington, 2002.
Amendment 1 to AS/NZS 4859.1:02	Standards Australia, Sydney, Standards New Zealand, Wellington, 2006.
ASTM C167-09	Standard Test Methods for Thickness and Density of Blanket or Batt Thermal Insulations. American Society for Testing and Materials, Philadelphia, PA, 1998.
ASTM C653-97 (07)	Standard Guide for Determination of the Thermal Resistance of Low- Density Blanket-Type Mineral Fiber Insulation. American Society for Testing and Materials, Philadelphia, PA, 1997.
ASTM C518-10	Standard Test Method for Steady-State Heat Thermal Transmission Properties by Means of the Heat Flow Meter Apparatus. American Society for Testing and Materials, Philadelphia, PA, 2010.
BRANZ Info. sheet	Notes on R-value measurement using ASTM C653 procedure. BRANZ, Jul., 2008.
BRANZ Info. sheet	Glossary of terms used in Table 6 of Thermal Test Reports. BRANZ, Feb., 2008.

8. LIST OF TABLES & FIGURES

Table 1.	Product specifications
Table 2.	Conditioning of five sample segments
Table 3.	Test condition set-points
Table 4.	Measured results for the three test specimens
Table 5.	Regression-fit for measurements at 23°C mean temperature
Table 6.	Summary and analysis of results
Table 7.	Assessment of product compliance with labelled specifications

Figure 1. Graph of thermal conductivity measurements at 23°C mean temperature



SHH

SHH.

